

Backing You Up,
Everywhere



Solutions for every industry



CNC MACHINES




ATM MACHINES



SOLAR UPS




CALL CENTERS



PETROL PUMPS



SEWING MACHINES



MRI MACHINES



IT COMPANIES



AC DC PUMPS



DENTAL CHAIR & COMPRESSORS




DATA CENTERS



HOSPITALS

OUR SPECIALIZED PRODUCT



GYM UPS



UPS SYSTEM FOR LIFTS




UPS SYSTEM FOR PETROL PUMPS



UPS SYSTEM FOR HOSPITALS

AWARDS & CERTIFICATIONS




OFFLINE SPECIFICATION

1KVA-10KVA (1:1) Ø



STABILIZER SPECIFICATION

Standard	Confirms to latest IS-9815 & ISO 2026 standards
Rating	Upto 5000 KVA
Input Voltage Ranges	Single Phase :160V-260V, 140V-280V and 90V-270V (Can be customised) Three Phase : 270V - 460V, 250V-460V and 150V-460V (Can be customised)
Output Voltage Ranges	Single Phase : 220/230/240 ± 1% & Three Phase : 380/400/415 ± 1%
Output Perform (Optional)	110V output for imported equipments
Input Frequency	47 - 53 Hz
Response Time	Instantaneous (milisec)
Correction Speed	10 - 60V/sec (as required)
Correction Methods	Step less correction using variac
Cooling	Natural Air / Natural Oil
Efficiency	More than 98%
Duty Cycle	Continuous 24 Hrs.
Operation	Auto/Manual
No Load Loss	Less than 0.4%
Compatibility Test	Specially designed control card for faithful operation on Mains as well as DG Set
Suitability	Suitable for 100% Unbalanced/Balanced Supply & 100% Unbalanced/Balanced Loads
Operating Temperature	-15°C to 50°C above ambient

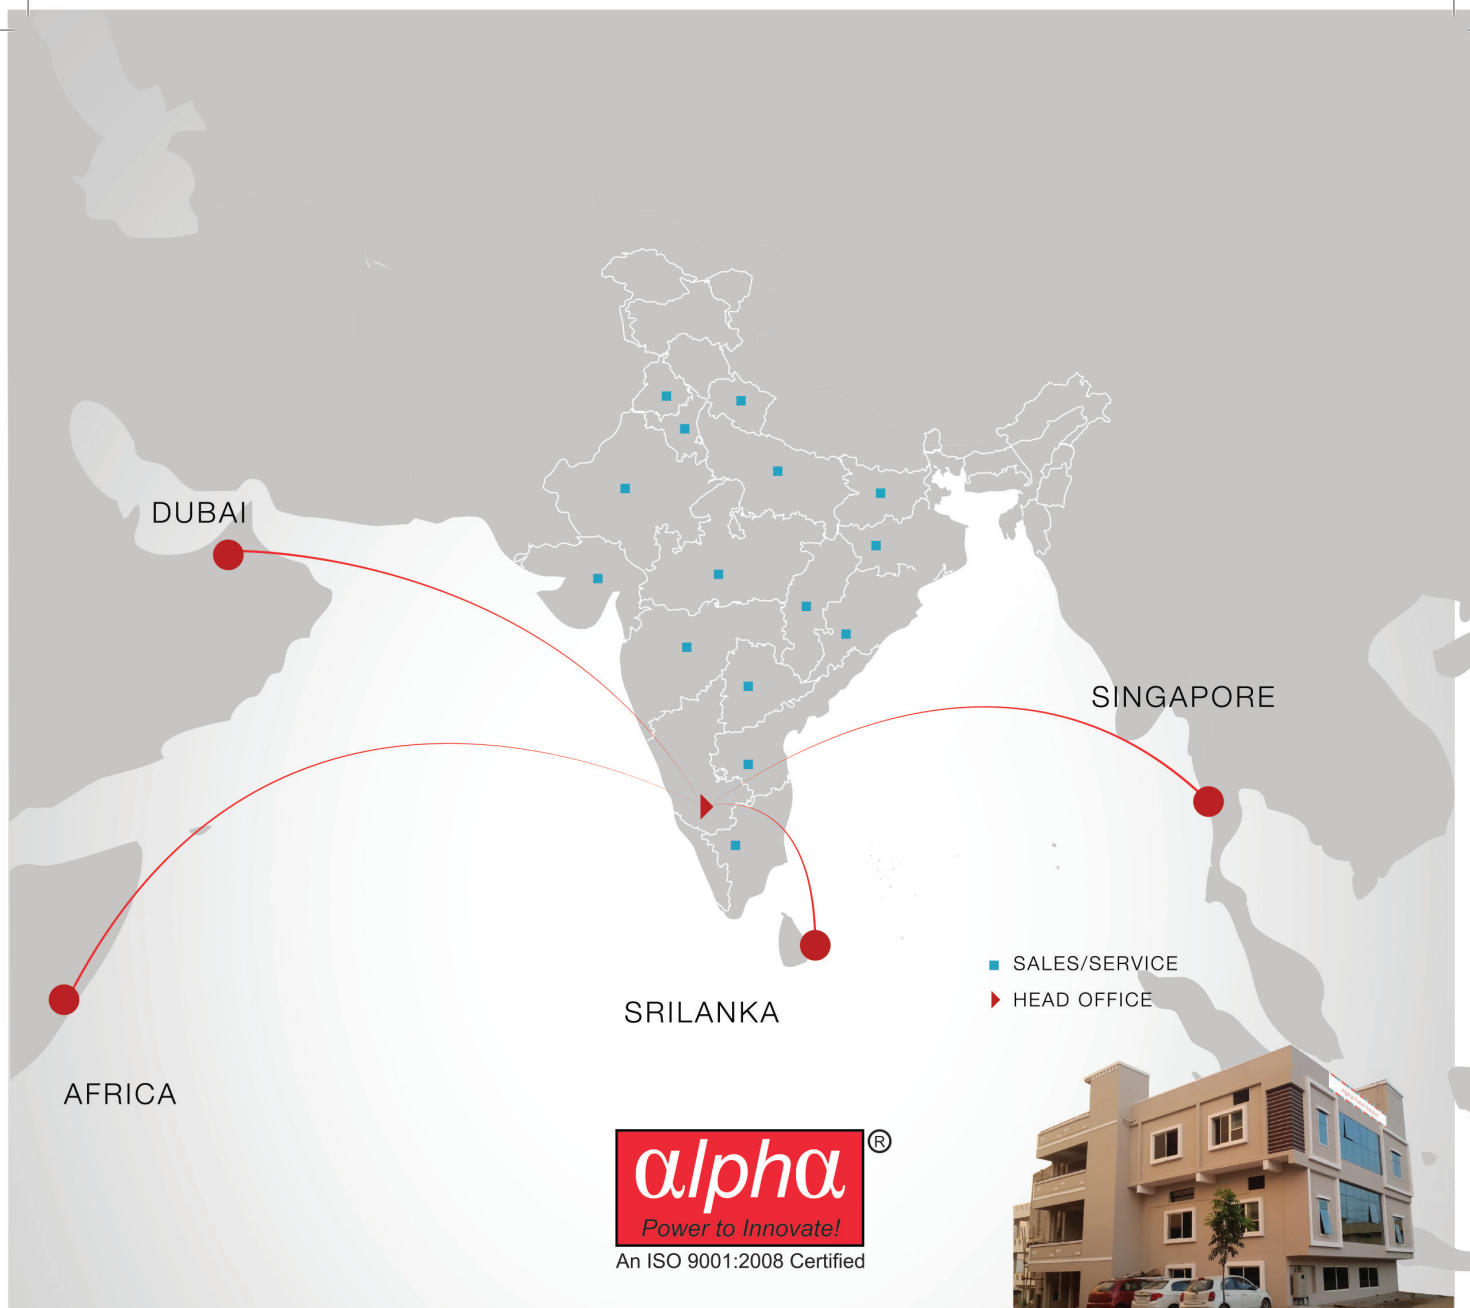

Alpha Power Solutions

Head Office

No,3662 & 3663, 5th Cross, Gayathrinagar,
Bangalore - 560 021,
Ph: +91-080 - 23322500 | 23326465
Email: alphapowersolutions@gmail.com

Unit 2 : No.23, 1st floor, 2nd cross, Nanda
Gokula Industrial area, Tigalarpalya, near
peenya 2nd stage, bangalore-560058

Unit 1

No 3644 & 3645, 4th Cross, Gayathrinagar,
Bangalore - 560 021,

Unit 3 : No.23, 4th floor, 2nd cross, Nanda
Gokula Industrial area, Tigalarpalya, near
peenya 2nd stage, bangalore-560058

Statutory Notice:

All batteries contain lead, which is harmful for humans & environment. As per statutory requirements, the used battery must be returned to the authorized dealer, manufacturer or at the designated collection centers.

This catalogue is issued to provide outline information only & is not deemed to form part of an offer or contract. Our policy is one of continued improvements & we reserve the right to change details without prior notice